




**Passive Fire  
Protection**

**Installation Drawing Catalogue  
Issue 3**

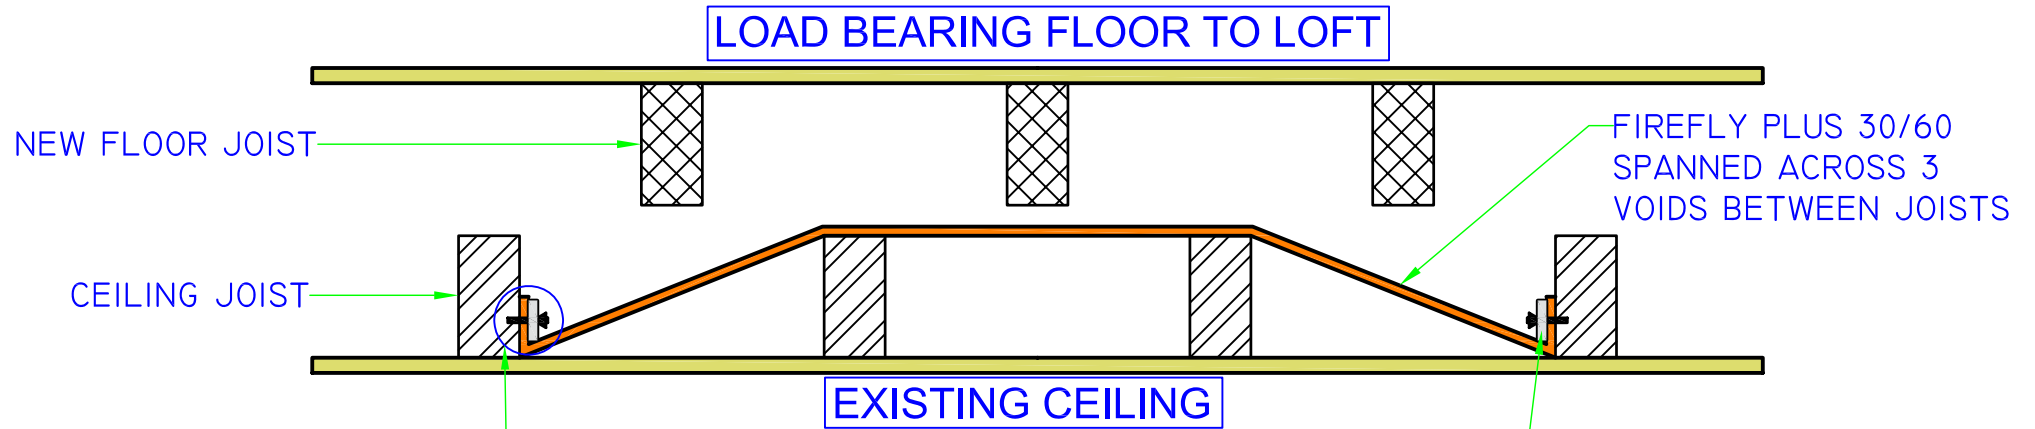


ENSURE THAT THE FIXING IS AS LOW AS POSSIBLE TO THE BASE OF THE JOIST TO PROTECT ANY TIMBER CHARRING THAT OCCURS

25MM X 0.5MM GALVANISED STRAP FIXED AT 250MM MAXIMUM CENTRES TO JOIST WITH SUITABLE FIRE RATED FASTENERS



		ALL RIGHTS RESERVED, NO PART OF THIS DRAWING MAY BE USED, REPRODUCED, ALTERED, STORED IN A RETRIEVAL SYSTEM OR TRANSMITTED IN ANY FORM OR BY ANY MEANS WITHOUT THE PRIOR WRITTEN PERMISSION OF TBA TEXTILES LIMITED. COPYRIGHT 2008.		<b>TBA TEXTILES LIMITED</b> Unit 3 Transpennine Trading Estate Gorrells Way, Rochdale OL11 2PX Tel: +44 (0)1706 758817 Fax: +44 (0)1706 750256 www.tbafirefly.co.uk		<b>DRAWN:</b> SNC	<b>TITLE:</b> FIREFLY/ PLUS 30/ PLUS 60 LOFTS - OVER JOISTS  <b>DRAWING No.</b> TBA/FLY/029
				<b>CHECKED:</b> MT			
				<b>APPROVED:</b> VF			
				<b>SCALE:</b> NTS			
<b>ISSUE</b>	<b>DESCRIPTION</b>			<b>DATE:</b> 26/05/08			

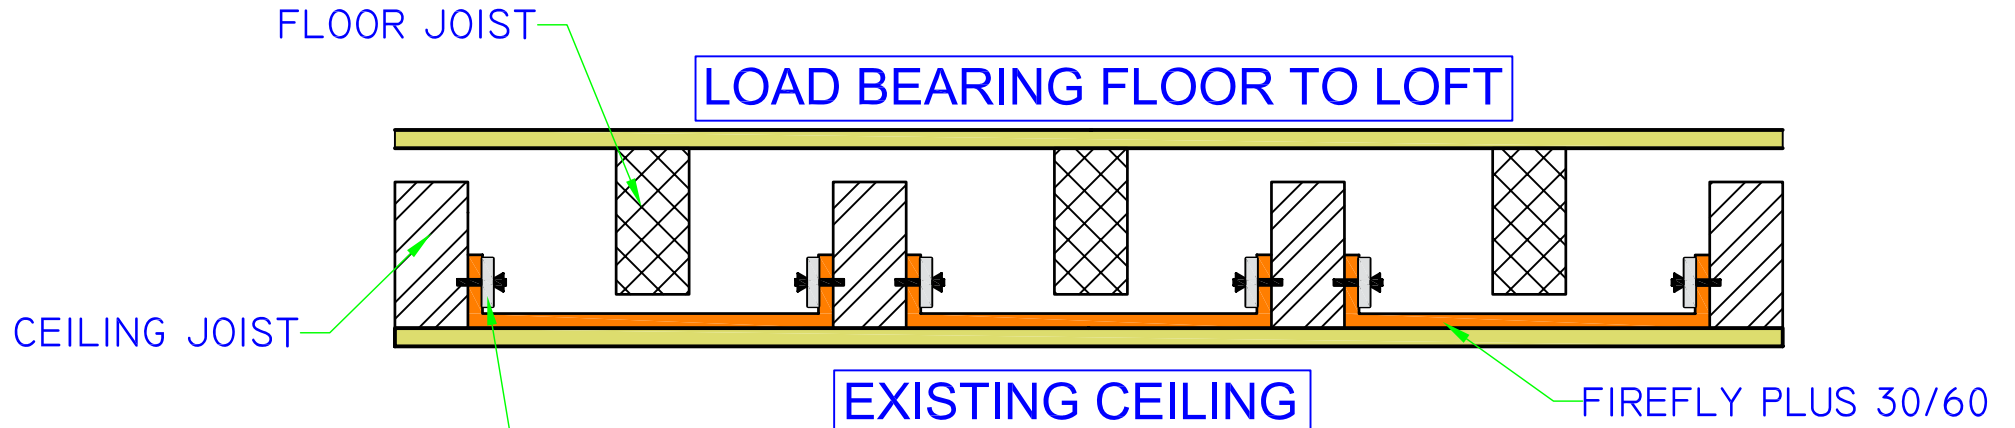

FIREFLY FIXED TO JOIST WITH 25MM X 0.5MM GALVANISED STRAP AT 250MM MAXIMUM CENTRES USING SUITABLE FIRE RATED FASTENERS

**INSTALLATION NOTE**

LAY THE FIREFLY OVER THE JOISTS. FIX AT THE FIRST JOIST, THEN CUT THE MATERIAL ALONG THE TOP OF THE NEXT JOIST AND FIX IN PLACE. REPEAT UNTIL COMPLETE.

THIS SYSTEM CAN BE USED WHEN THE LOAD BEARING JOISTS NEED TO BE LOWER IN THE JOIST SECTION.



		ALL RIGHTS RESERVED, NO PART OF THIS DRAWING MAY BE USED, REPRODUCED, ALTERED, STORED IN A RETRIEVAL SYSTEM OR TRANSMITTED IN ANY FORM OR BY ANY MEANS WITHOUT THE PRIOR WRITTEN PERMISSION OF <b>TBA TEXTILES LIMITED.</b> COPYRIGHT 2008.		<b>TBA TEXTILES LIMITED</b> Unit 3 Transpennine Trading Estate Gorrells Way, Rochdale OL11 2PX Tel: +44 (0)1706 758817 Fax: +44 (0)1706 750256 www.tbafirefly.co.uk		<b>DRAWN:</b> SNC	<b>TITLE:</b> FIREFLY/ PLUS 30/ PLUS 60 LOFTS - BETWEEN JOISTS  <b>DRAWING No.</b> TBA/FLY/030
				<b>CHECKED:</b> MT			
				<b>APPROVED:</b> VF			
				<b>SCALE:</b> NTS			
<b>ISSUE</b>	<b>DESCRIPTION</b>					<b>DATE:</b> 26/05/08	